




NOTES:

1. DIMENSIONS CAN BE CHANGED BY MANUFACTURER WITHOUT NOTICE.
2. DIMENSIONS DO NOT IMPLY TOLERANCE.

FAZ-B15-1-NA-SP

Units: inches [mm]  
Scale: Full

EATON MINIATURE CIRCUIT  
BREAKER: 1-POLE, 15A

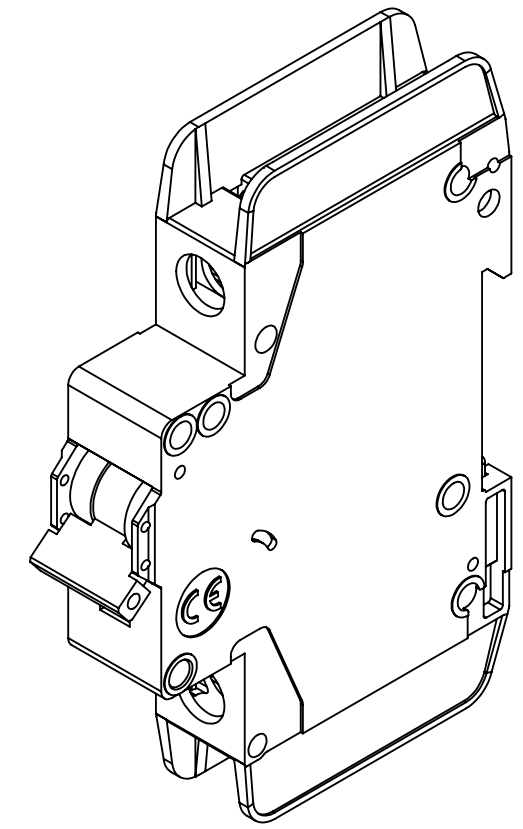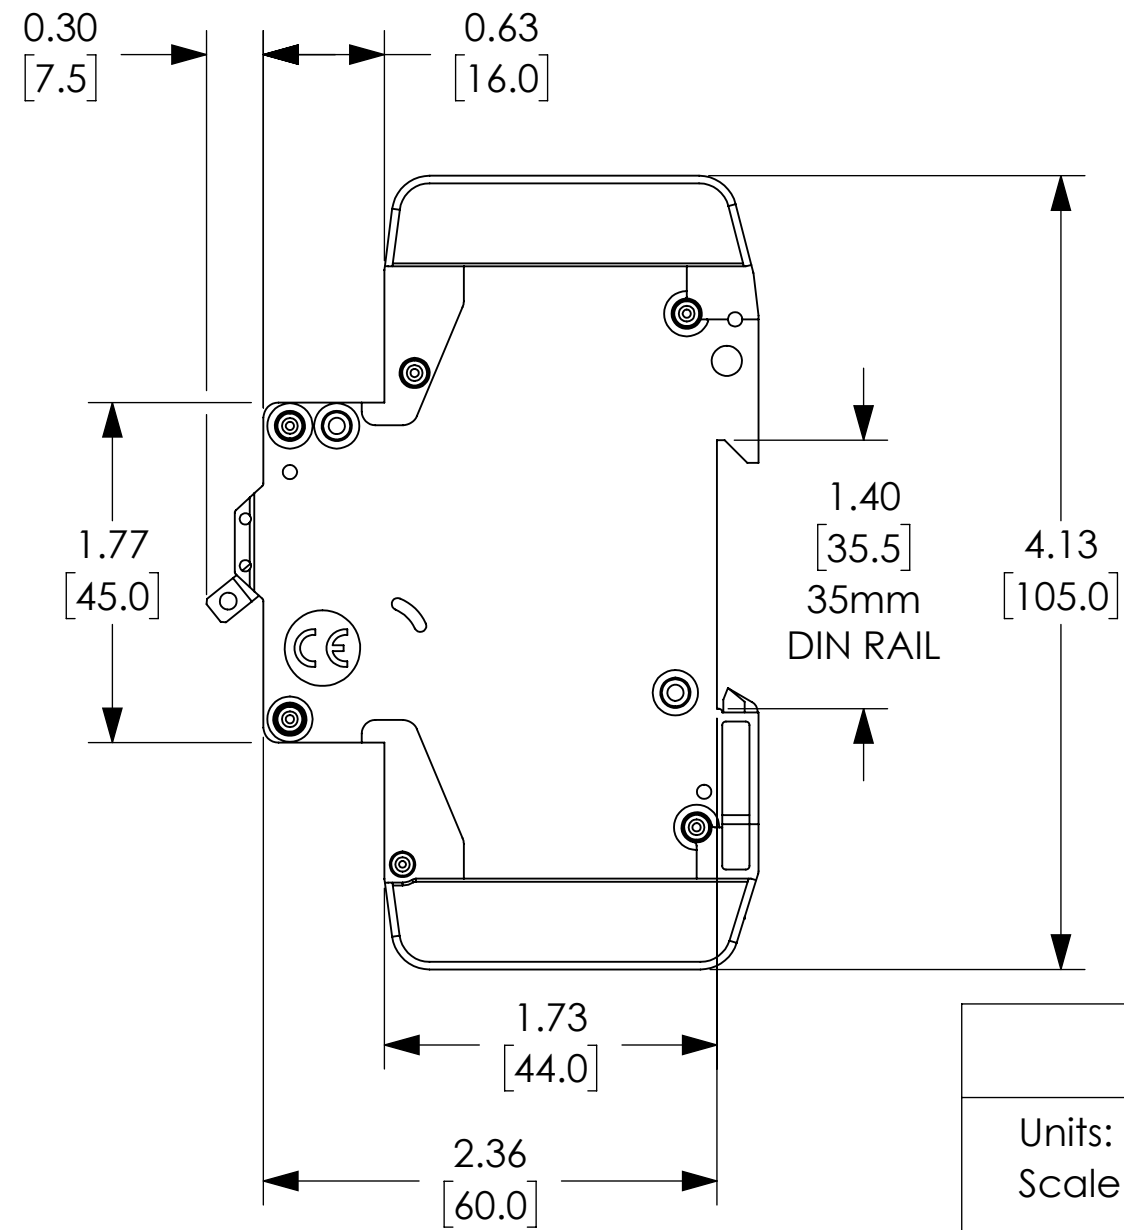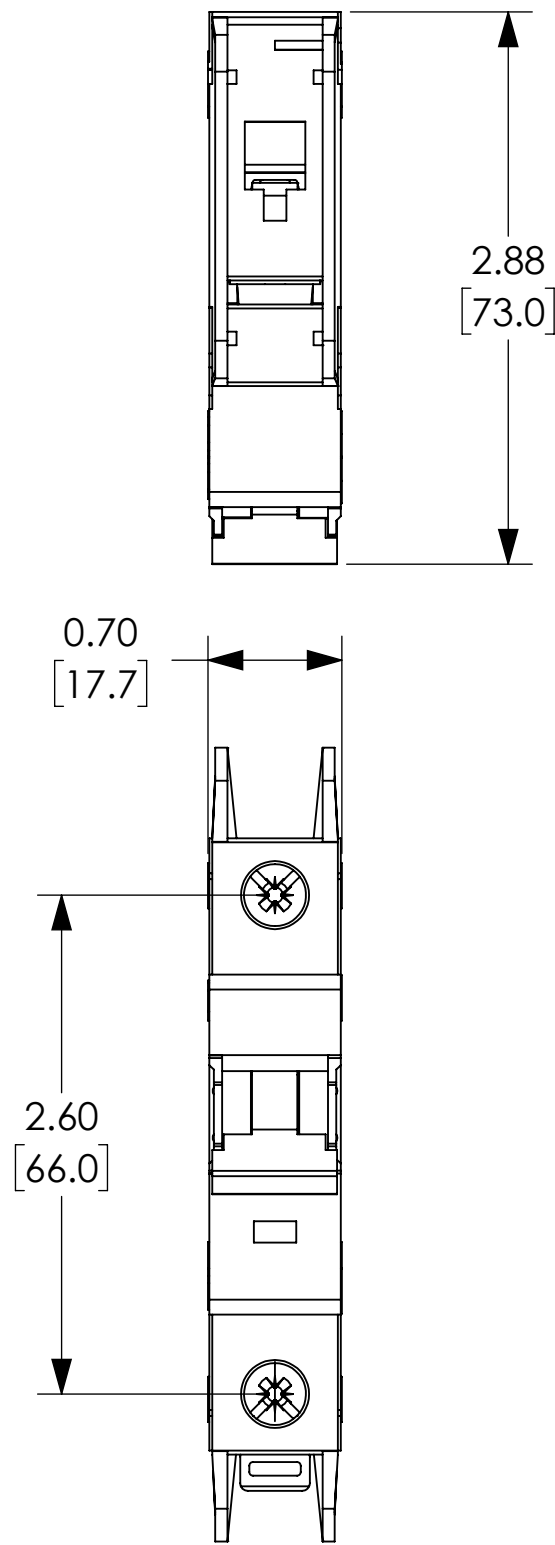

NOTES:

1. DIMENSIONS CAN BE CHANGED BY MANUFACTURER WITHOUT NOTICE.
2. DIMENSIONS DO NOT IMPLY TOLERANCE.

FAZ-B20-1-NA-SP





Units: inches [mm]  
Scale: Full

EATON MINIATURE CIRCUIT  
BREAKER: 1-POLE, 20A

BILL OF MATERIALS				
NO.	DESCRIPTION	PART NO.	MANUFACTURER	QTY.
1	NEMA4 LP ENCLOSURE	SCE-24H2408LP	SAGINAW CONTROL ENGINEERING	1
2	ENCLOSURE SUBPANEL, BENT GALVANIZED	SCE-24P24GALV	SAGINAW CONTROL ENGINEERING	1
3	CABLE DUCT, 1.0"x1.5"	----	----	1
4	DIN RAIL, SLOTTED, 35mm	----	----	1
5	TERMINAL BLOCKS, END ANCHOR	----	----	2
6	TERMINAL BLOCKS, GROUND	----	----	1
7	TERMINAL BLOCK, SINGLE, FEEDTHROUGH, GREY	----	----	2
8	CIRCUIT BREAKER, 1-POLE, 20A, B-CURVE	FAZ-B20/1-NA	EATON	1
9	CIRCUIT BREAKER, 1-POLE, 15A, B-CURVE	FAZ-B15/1-NA	EATON	1
10	QUINT4-UPS/1AC/1AC/1KVA UPS	2320283	PHOENIX CONTACT	1
11	QUINT4-UPS MOUNTING BRACKET	UWA-130	PHOENIX CONTACT	2
12	UPS-BAT/PB/24DC/12AH - BATTERY MODULE	1274119	PHOENIX CONTACT	1
13	GROUND BAR	----	----	1

REV 0





XXXXX  
XXXXXXXXXXXX  
PANEL LAYOUT

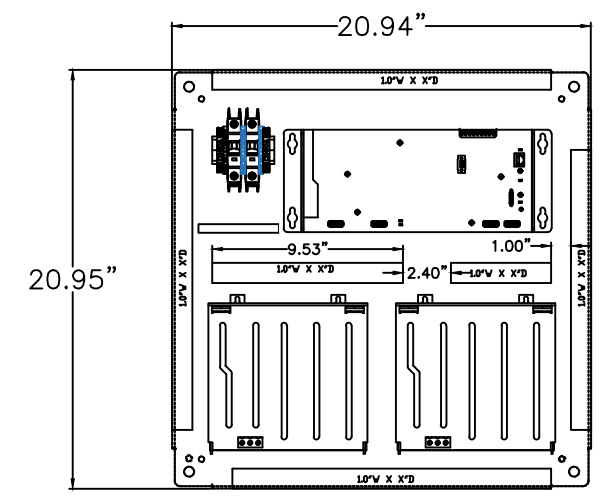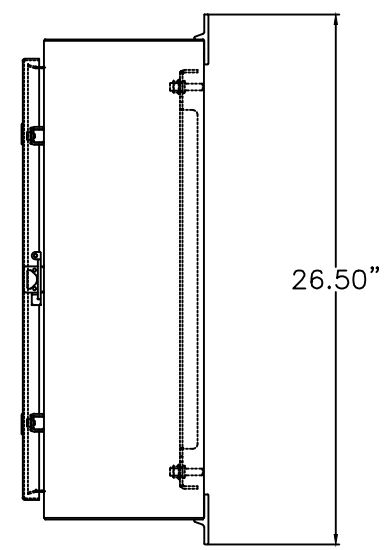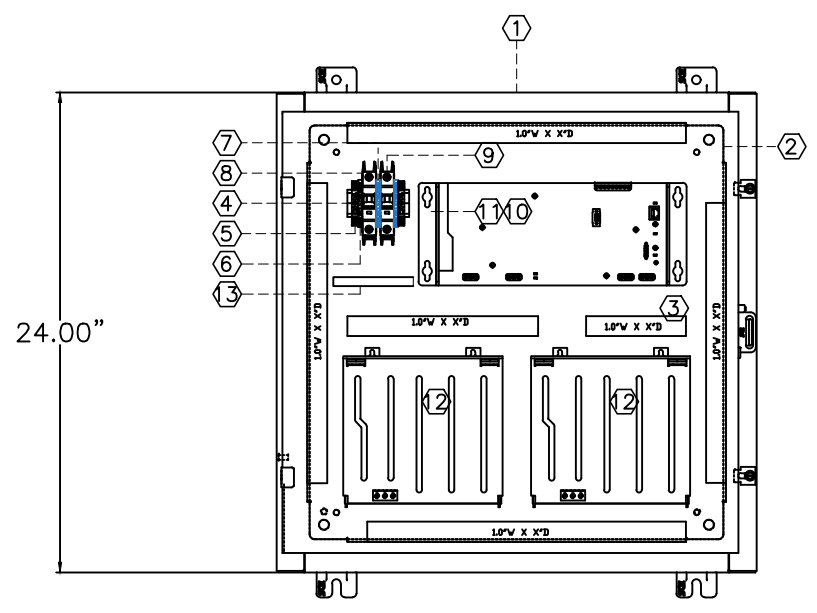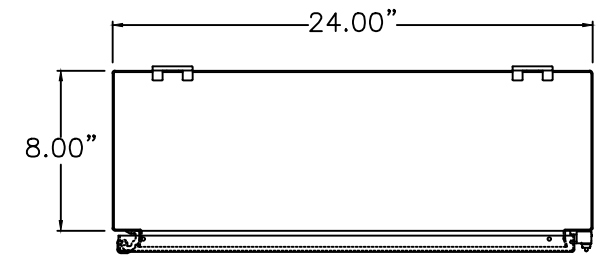

5			
4			
3		AS BUILT	
2	xx/xx/xxx	CUST MARKUPS	xxx
1	xx/xx/xxx	AS INSTALLED	xxx
0	02/26/2024	AS DESIGNED	RF
#	DATE	REVISION	BY
DWG TITLE			
UPS PANEL BILL OF MATERIALS (BOM)			
ENGINEER	xxxx	CHECKED BY	xx
JOB#	xxxxx	DRAWN BY	RF
SCALE	xxx	DATE	xx/xx/xx
DWG#			xxx
SHEET#			

REV 0

XXXXX  
XXXXXXXXXXXX  
PANEL LAYOUT

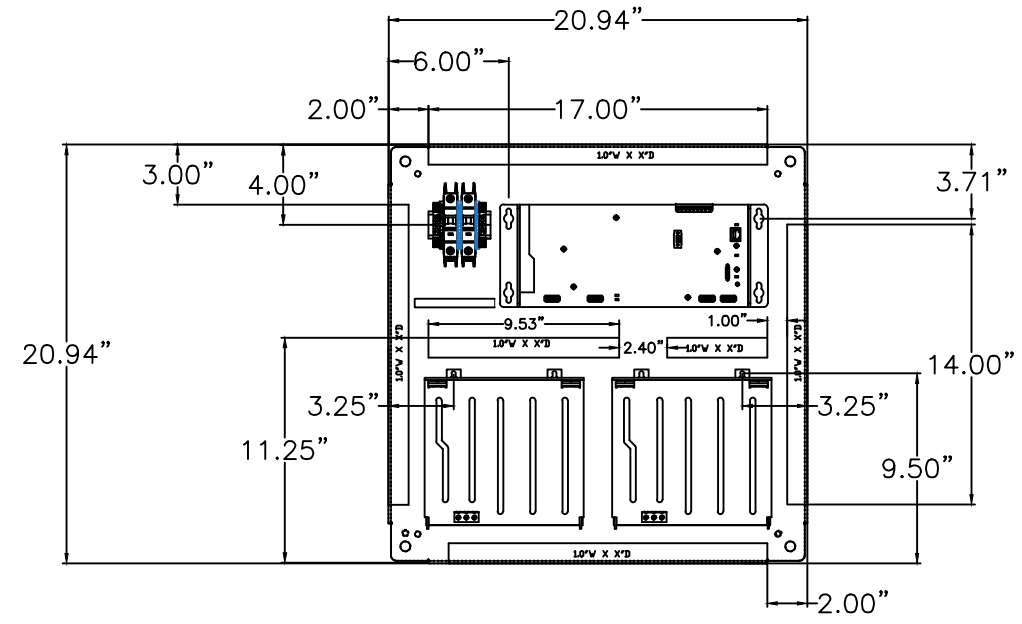
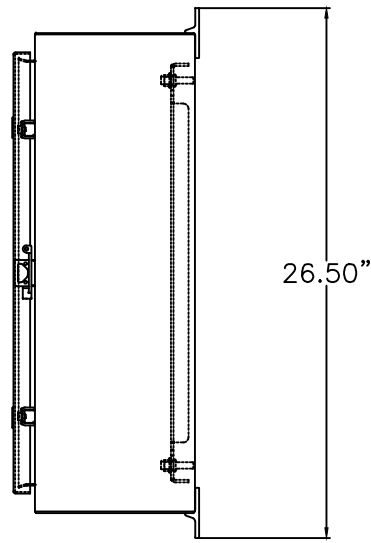
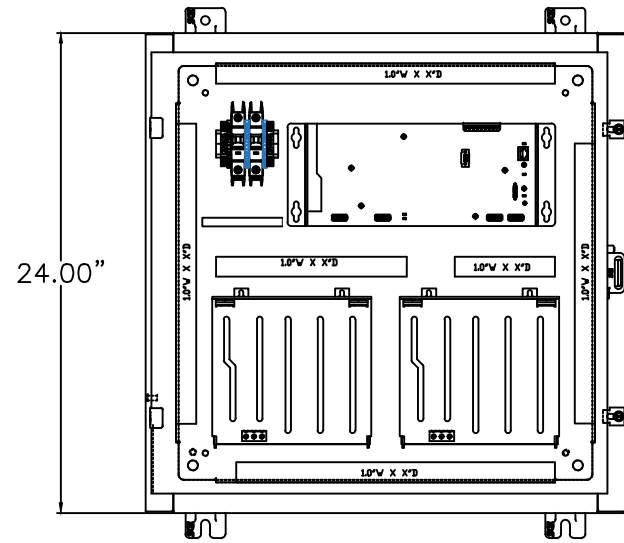
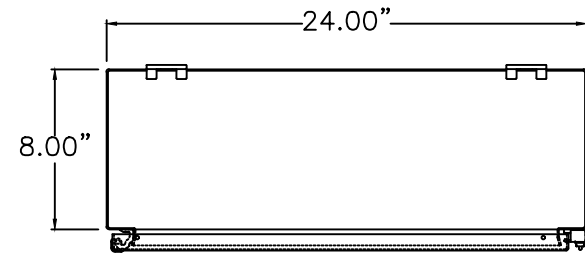


5			
4			
3	AS BUILT		
2	xx/xx/xxx CUST MARKUPS	xxx	
1	xx/xx/xxx AS INSTALLED	xxx	
0	02/26/2024 AS DESIGNED	RF	
#	DATE	REVISION	BY
DWG TITLE			
UPS PANEL LAYOUT			
ENGINEER	xxxx	CHECKED BY	xx
JOB#	xxxxx	DRAWN BY	RF
SCALE	xxx	DATE	xx/xx/xx
DWG#	xxx		
SHEET#			

BILL OF MATERIALS				
NO.	DESCRIPTION	PART NO.	MANUFACTURER	QTY.
1	NEMA4 LP ENCLOSURE	SCE-24H2408LP	SAGINAW CONTROL ENGINEERING	1
2	ENCLOSURE SUBPANEL, BENT GALVANIZED	SCE-24P24GALV	SAGINAW CONTROL ENGINEERING	1
3	CABLE DUCT, 1.0"x1.5"	----	----	1
4	DIN RAIL, SLOTTED, 35mm	----	----	1
5	TERMINAL BLOCKS, END ANCHOR	----	----	2
6	TERMINAL BLOCKS, GROUND	----	----	1
7	TERMINAL BLOCK, SINGLE, FEEDTHROUGH, GREY	----	----	2
8	CIRCUIT BREAKER, 1-POLE, 20A, B-CURVE	FAZ-B20/1-NA	EATON	1
9	CIRCUIT BREAKER, 1-POLE, 15A, B-CURVE	FAZ-B15/1-NA	EATON	1
10	QUINT4-UPS/1AC/1AC/1KVA UPS	2320283	PHOENIX CONTACT	1
11	QUINT4-UPS MOUNTING BRACKET	UWA-130	PHOENIX CONTACT	2
12	UPS-BAT/PB/24DC/12AH - BATTERY MODULE	1274119	PHOENIX CONTACT	1
13	GROUND BAR	----	----	1

REV 0





XXXXX  
XXXXXXXXXXXX  
PANEL LAYOUT

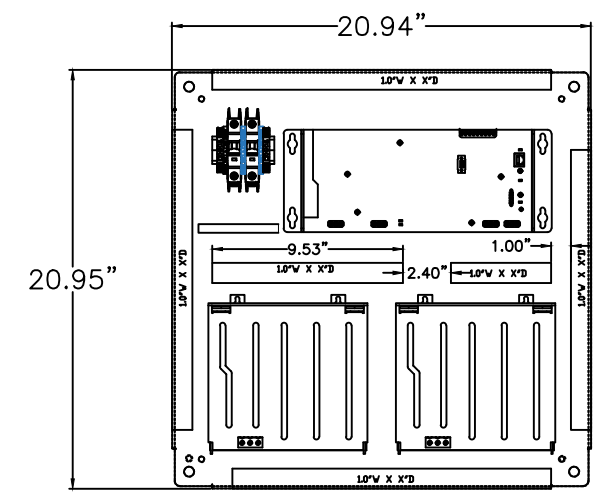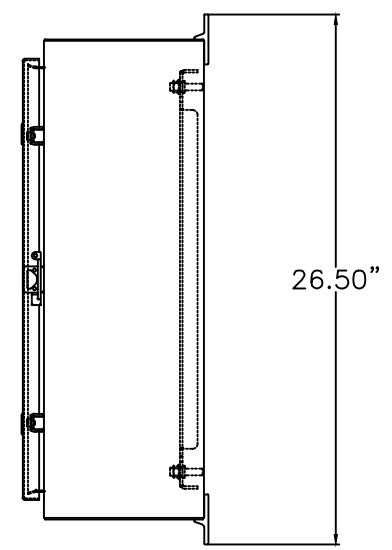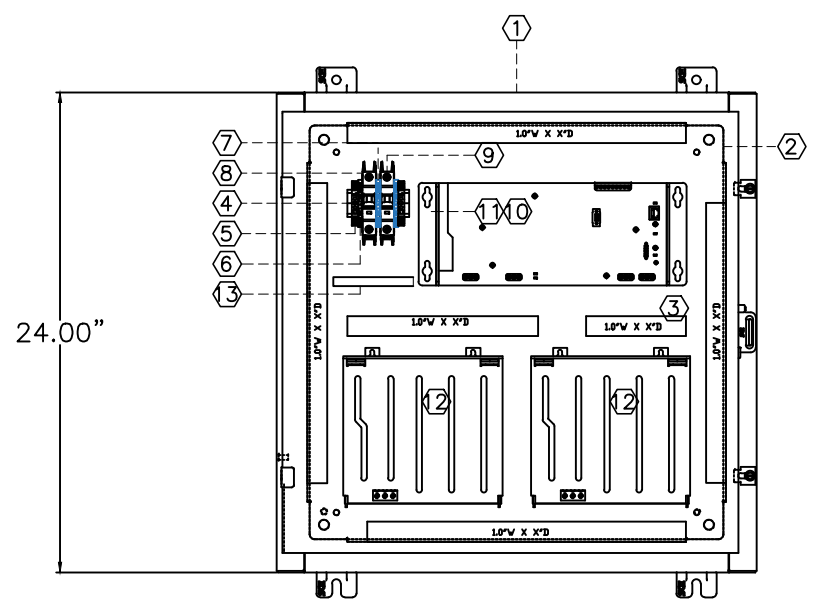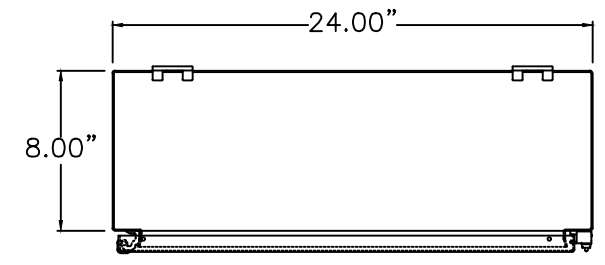

5			
4			
3	AS BUILT		
2	xx/xx/xxx	CUST MARKUPS	xxx
1	xx/xx/xxx	AS INSTALLED	xxx
0	02/26/2024	AS DESIGNED	RF
#	DATE	REVISION	BY
DWG TITLE			
UPS PANEL BILL OF MATERIALS (BOM)			
ENGINEER	xxxx	CHECKED BY	xx
JOB#	xxxxx	DRAWN BY	RF
SCALE	xxx	DATE	xx/xx/xx
DWG#	xxx		
SHEET#			

REV 0

XXXXX  
XXXXXXXXXXXX  
PANEL LAYOUT

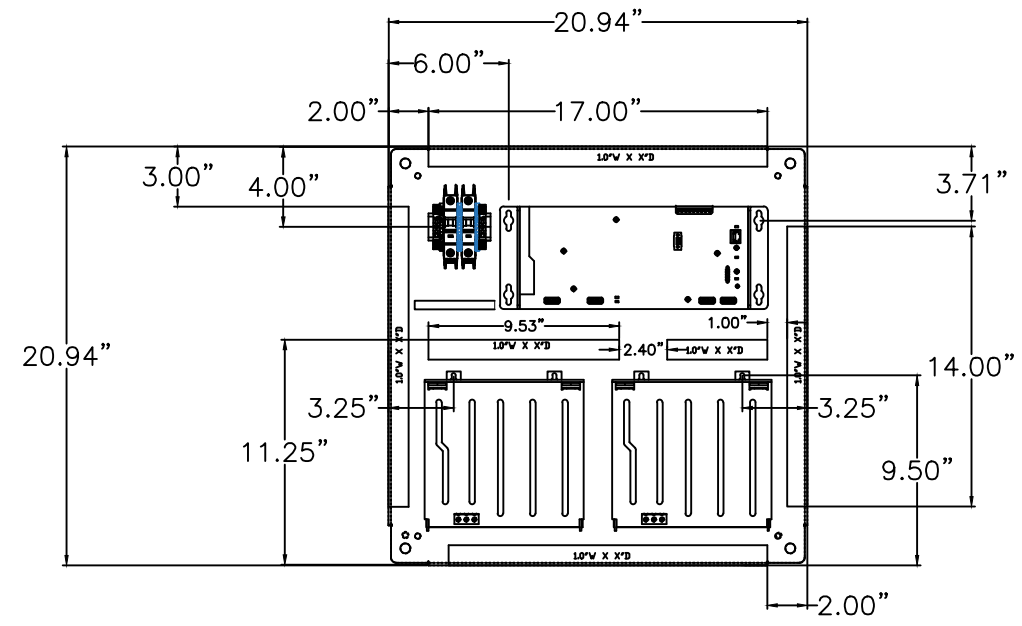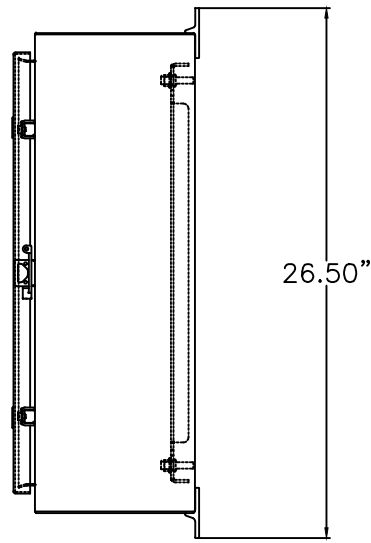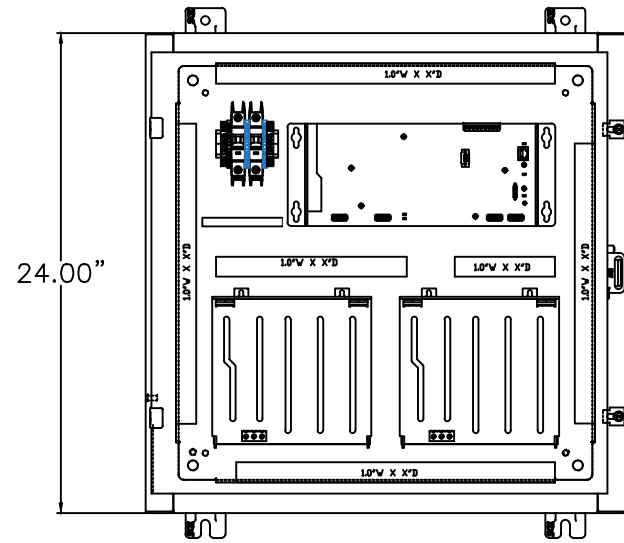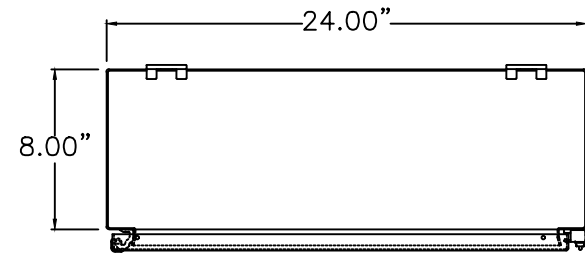

5			
4			
3	AS BUILT		
2	xx/xx/xxx CUST MARKUPS	xxx	
1	xx/xx/xxx AS INSTALLED	xxx	
0	02/26/2024 AS DESIGNED	RF	
#	DATE	REVISION	BY

DWG TITLE

UPS PANEL LAYOUT

ENGINEER	CHECKED BY
xxxx	xx
JOB#	DRAWN BY
xxxxx	RF
SCALE	DATE
xxx	xx/xx/xx
DWG#	xxx
SHEET#	